


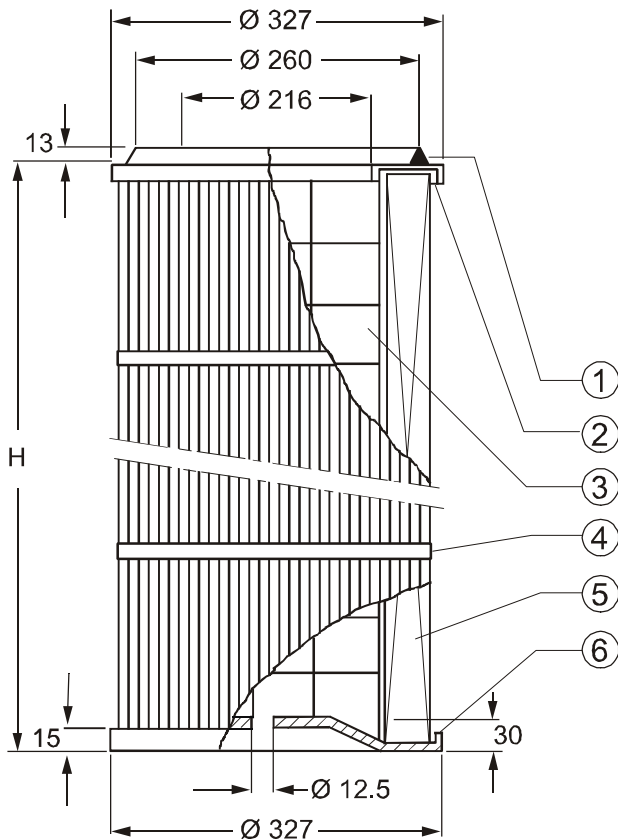

List of parts

Title	Number
① Gasket, PUR	1
② Cover, steel galvanized	1
③ Support cage	1
④ Outer straps, PES	2
⑥ Pleated media	1
⑦ Bottom, steel galvanized	1

Type **LP 327 S 60 A 12 06**

Filter media: FE 2506-01-sine, PES
(antistatic)

Number of pleats: 220

Filter surface: 12.6 [m²]

Height of cartridge H: 605 [mm]


Depth of pleats: 48 [mm]

Filter cartridge for dust removal according to our separate application guidelines

- Cartridge with integrated expanded metal/wire-support cage.
- Filter media fulfils dust class M according DIN EN 60335-2-69 annex AA.
- **Antistatic cartridge:** The user has to ground the cartridge versus the filter housing by metallic contact between the cartridge bottom and the mounting plate.

The values given are mean values with tolerances resulting from normal production fluctuations.
Our explicit written confirmation is always required for the correctness and applicability of the particulars involved in any individual case.
All preceding versions are hereby rendered invalid.

Issued: August 2003/KS/Ka

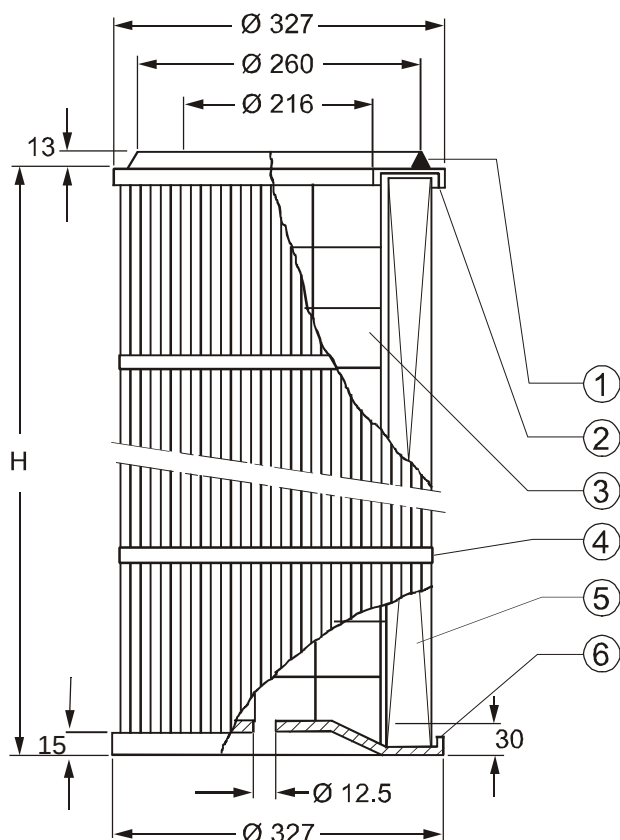

Stückliste

Titel	Anzahl
① Dichtung, PUR	1
② Deckel, Stahl verzinkt	1
③ Stützkorb	1
④ Äußere Fixierbänder, PES	2
⑤ Faltenbalg	1
⑥ Boden, Stahl verzinkt	1

Type **LP 327 S 60 A 12 06**

Filtermedium: FE 2506-01-sinus, PES
(antistatisch)

Faltenanzahl: 220

Filterfläche: 12,6 [m²]
Patronenhöhe H: 605 [mm]
Faltentiefe: 48 [mm]

Filterpatrone zur Staubabscheidung nach Maßgabe unserer separaten Anwendungsrichtlinien

- Patrone mit integriertem Streckmetall/Draht-Stützkorb.
- Gemäß DIN EN 60335-2-69 Annex AA erfüllt das Filtermedium Staubklasse M.
- **Antistatische Patrone:** Geerdet gegenüber dem Filtergehäuse durch metallischen Kontakt zwischen Boden und Montageplatte.

Bei den angegebenen Zahlenwerten handelt es sich um Mittelwerte mit Toleranzen infolge üblicher Produktionsschwankungen.
Für die Richtigkeit der Angaben und deren Übertragbarkeit bedarf es im konkreten Einzelfall unserer ausdrücklichen, schriftlichen Bestätigung. Alle Vorgängerversionen verlieren hiermit ihre Gültigkeit.

Stand: August 2003/KS/Ka